



eco-scan bvba
 Industrieweg 114H
 B-9032 Wondelgem
 Belgium
 BTW nr.: BE 0887 763 992

www.eco-scan.be

NOISE LAB
REPORT Number ASTM-2018_ES_211-I101_43432_E

Customer : **Kinetics Middle East, LLC**
P.O. Box: 37670
Dubai
United Arab Emirates

Contacts : Client : Karim Abouseda
 Noise lab : Volker Spessart

Tests : Laboratory measurement of airborne sound insulation of building elements
Product name : **KINLAYMENT 5mm**

Reference norm :
 ASTM E 90 - 04 Standard Test Method for Laboratory Measurement of
 Airborne Sound Transmission Loss of Building Partitions and Elements

Various other related norms:
 ASTM E 413 - 10 Classification for Rating Sound Insulation

NBN EN ISO 10140-1:2010 Acoustics - Laboratory measurement of sound insulation of building elements
 - Part 1: Application rules for specific products
 NBN EN ISO 10140-4:2010 Acoustics - Laboratory measurement of sound insulation of building elements
 - Part 4: Measurement procedures and requirements
 NBN EN ISO 10140-5:2010 Acoustics - Laboratory measurement of sound insulation of building elements
 - Part 5: Requirements for test facilities and equipment

To perform the above ISO measurements, the laboratory of eco-scan is accredited by BELAC "The Belgian Accreditation Body"
BELAC is a signatory of all existing MLAs (multilateral agreements) and MRAs (multilateral recognition agreements) of EA (European co-operation for Accreditation), ILAC (International Laboratory Accreditation Cooperation) and IAF (International Accreditation Forum).
In this way, reports and certificates issued by BELAC accredited bodies are internationally accredited.

Date and reference of the request:	8-Nov-2018	2018_ES_211
Date of receipt of the specimen (s):	27-Nov-2018	SONI101
Date of tests:	28-Nov-2018	
Date of preparation of the report:	30-Nov-2018	

This test report together with its annexes contains : 7 pages and must be multiplies only in its entirety

Technical Manager,

Volker Spessart



eco-scan bvba
 Industrieweg 114H
 B-9032 Wondelgem
 Belgium
 BTW nr.: BE 0887 763 992

www.eco-scan.be

NOISE LAB
REPORT Number ASTM-2018_ES_211-I101_43432_E

MEASURING EQUIPMENT

Sound Sources

Omnidirectional Sound Source: OUTLINE model GSR Globe Source
 Extension Range Subwoofer: OUTLINE model GSS-SP

Microphone and data acquisition system:

Brüel & Kjaer - 4189 : 1/2" free field microphone, 6Hz to 20kHz, prepolarized
 Brüel & Kjaer - ZC-0032 : 1/2" microphone preamplifier
 Brüel & Kjaer - JP 1041 : dual 10-pole adaptor JP-1041
 Brüel & Kjaer - 3923 : rotating microphone boom
 Brüel & Kjaer - 4231 : Sound calibrator 94&114dB SPL-1000Hz, Fulfills IEC 60942(2003)Class1
 Brüel & Kjaer - 2270 : Sound level meter - dual channel instrument (measuring both channels simultaneously)
 Conforms with IEC 61672-1 (2002-05) Class 1

Two rotating microphone systems, one in the receiving room, one in the source room

Number of source positions:	3
<i>Minimum 3m between the different source positions</i>	
Number of microphone positions for each source position:	3
<i>Microphone position with a rotating microphone</i>	
Number of rotations:	3
Rotation speed:	16 s/tr
Minimum rotation time:	30 s
<i>Just not a rotation angle <10 ° to the chamber surfaces</i>	

Data processing

Brüel & Kjaer - BZ-5503 : utility software for hand-held analyzers
 Brüel & Kjaer - BZ-7229 : dual-channel building acoustics software
 Brüel & Kjaer - 7830 :Qualifier Software for reporting of results
 A computer with proprietary software

Averaging Time per measurement:	48 s
Number of reverberation time measurements (with graphic control):	27

Test chambers

Volume source room:	144 m ³	=	5084.6 ft ³
Volume receiving room:	51.4 m ³	=	1814.9 ft ³
Total partition wall area:	12.00 m ²	=	129.1 ft ²
Surface test opening:	12.00 m ²	=	129.1 ft ²

There is absorption material applied in the test rooms

Partition wall

n/a

eco-scan bvba
Industrieweg 114H
B-9032 Wondelgem
Belgium
BTW nr.: BE 0887 763 992

www.eco-scan.be


NOISE LAB
REPORT Number **ASTM-2018_ES_211-I101_43432_E**

SPECIAL MEASUREMENT CONDITIONS

Receiving Room volume < 80 m³

Sound insulation test facilities

The test rooms meet the requirements of ISO 10140-5
Both rooms are isolated for vibrations by using a so called room-in-room construction.

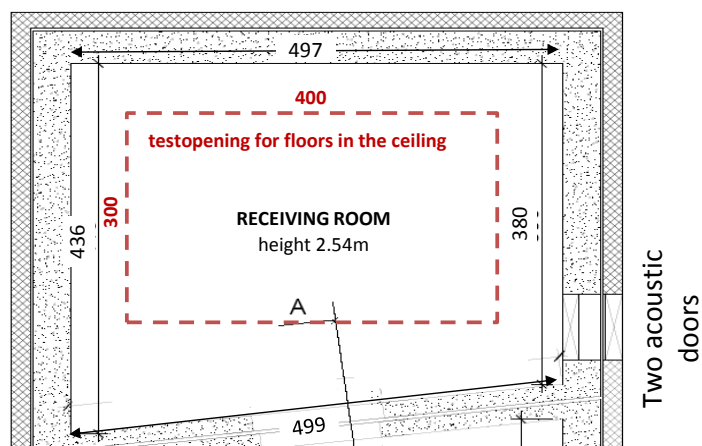



eco-scan bvba
 Industrierweg 114H
 B-9032 Wondelgem
 Belgium
 BTW nr.: BE 0887 763 992

www.eco-scan.be

NOISE LAB
REPORT Number ASTM-2018_ES_211-I101_43432_E

Sound Transmission Loss Test Data

Test: ASTM E 90 - 04 / ASTM E 413 - 10			
Client: Kinetics Middle East, LLC		Date of test: 28 November 2018	
<i>Description of the test setup:</i>			
45 mm	= (1.77 inch)	prefab anhydrite screed slab	
5 mm	= (0.20 inch)	KINLAYMENT 5mm	
140 mm	= (5.51 inch)	heavyweight standard floor = solid reinforced concrete slab	
<i>Source room:</i>		<i>Receiving room:</i>	
Temperature:	18.9 °C = 66.0 °F	Temperature:	18.6 °C = 65.5 °F
Atmospheric pressure:	60 hPa = 0.87 psi	Atmospheric pressure:	60 hPa = 0.87 psi
Relative humidity:	1012 %RH	Relative humidity:	1012 %RH
Volume:	144 m ³ = 5084.6 ft ³	Volume:	51.4 m ³ = 1814.9 ft ³
<i>Reference floor area:</i>	12.0 m ² = 129.1 ft ²		
<i>Tested floor area:</i>	12.0 m ² = 129.1 ft ²		

f	R	(*)	(**)	STL
(Hz)	(dB)			(dB)
50		b		
63				
80				
100	38.1			38
125	39.0			39
160	40.4			40
200	45.4			45
250	47.0			47
315	51.0			51
400	57.0			57
500	60.7			61
630	63.7			64
800	67.9	b		68
1000	70.5	b		71
1250	70.8	b		71
1600	69.5			70
2000	66.0			66
2500	66.4			66
3150	69.1	b		69
4000	71.2	b		71
5000	74.6	B		75

ASTM E 413 - 10	Sound Transmission Class STC (dB)	60	Sum of Unfavorable Deviations [dB] -30
			Max. Unfavorable Deviation [dB]:
			-7 at 160 Hz

(*) b : background noise correction used

 B : Maximum background noise correction used

(**) m : flanking transmission correction used

 M : Maximum flanking transmission correction used

 B or M : R >= value shown

R:

STL : Sound Transmission Loss



eco-scan bvba
 Industrieweg 114H
 B-9032 Wondelgem
 Belgium
 BTW nr.: BE 0887 763 992

www.eco-scan.be

NOISE LAB
REPORT Number ASTM-2018_ES_211-I101_43432_E

STL

Sound Transmission Loss Test Data

ASTM E 90 - 04 / ASTM E 413 - 10

Client: Kinetics Middle East, LLC

Date of test: 28 November 2018

Description of the test setup:


45 mm	= (1.77 inch)	prefab anhydrite screed slab
5 mm	= (0.20 inch)	KINLAYMENT 5mm
140 mm	= (5.51 inch)	heavyweight standard floor = solid reinforced concrete slab

Area S of separating element: 12.00 m² = 129.1 ft²

Receiving room volume: 51.4 m³ = 1814.9 ft³

Source room volume: 144 m³ = 5084.6 ft³

frequency Hz	STL one third octave dB
50	
63	
80	
100	38
125	39
160	40
200	45
250	47
315	51
400	57
500	61
630	64
800	68
1000	71
1250	71
1600	70
2000	66
2500	66
3150	69
4000	71
5000	75

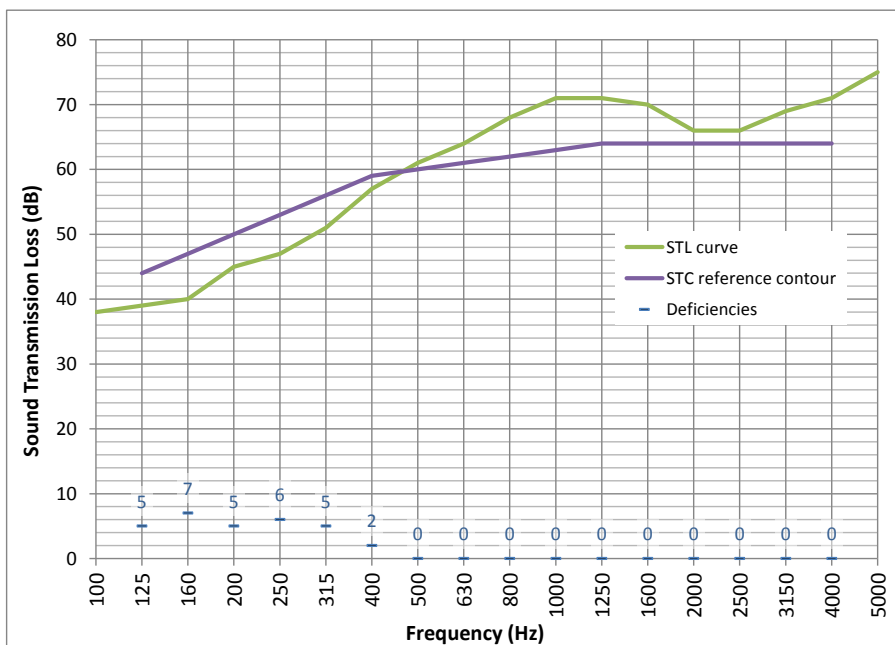

Sound Transmission Class STC (dB): 60



eco-scan bvba
 Industrieweg 114H
 B-9032 Wondelgem
 Belgium
 BTW nr.: BE 0887 763 992

www.eco-scan.be

NOISE LAB
REPORT Number ASTM-2018_ES_211-I101_43432_E

ANNEX 2: Description test items by manufacturer

The test sample description given by manufacturer is checked visually as good as possible by the laboratory.

The correspondence between the test element and the commercialized product is the sole responsibility of the manufacturer

Description of the test element as a layered structure

	Thickness (mm)	ρ (kg/m ³)	m" (kg/m ²)	m" (PSF)	Description of the layer
1	45		90	18.4	prefab anhydrite screed slab
2	5				KINLAYMENT 5mm
3	140	2300	322	65.9	heavyweight standard floor = solid reinforced concrete slab
4					
5					
6					
7					
8					
9					
10					

Total thickness = 190 mm = (7.48 inch)

KINLAYMENT 5mm

It is a floating floor underlayer product for impact and airborne sound isolation.

eco-scan bvba
Industrieweg 114H
B-9032 Wondelgem
Belgium
BTW nr.: BE 0887 763 992

www.eco-scan.be

NOISE LAB
REPORT Number **ASTM-2018_ES_211-I101_43432_E**

ANNEX 4: photographs of the test element or the test arrangement

Description of the assembly or drawing or photo

The floating floor underlayer product was placed on the standard concrete floor.

Then a prefab anhydrite screed slab was placed on top.

The topfloor had no rigid contact with the test opening construction. Gaps between the topfloor and the test opening were filled-up with sound-absorbing material.

Additionally sandbags were placed around the perimeter edges

Remark: the sound-absorbing material and sandbags are not a part of the floating floor product.

